


## Accessible Emergency Shower and Eye Wash Station Installation Requirements

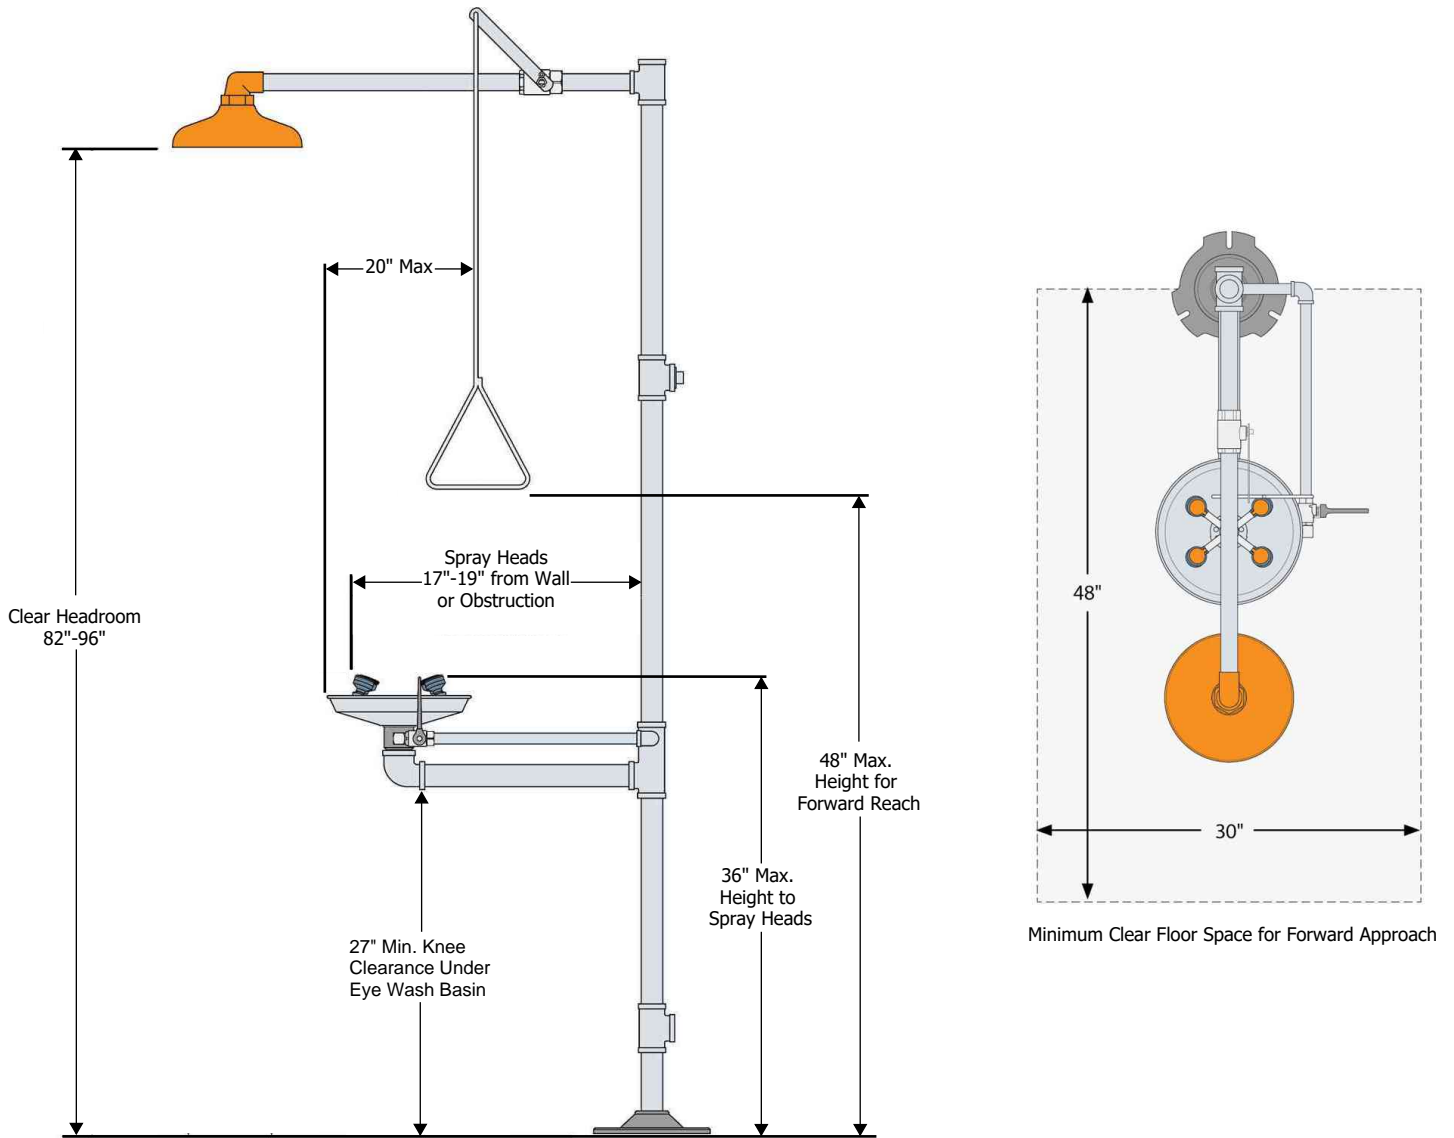

**Controls Operation:** Controls must be able to be operated without and grasping, pinching, twisting, or exerting more than 5 lbs of force.

All emergency showers, eye wash stations, and combined installations shall be in compliance with ANSI/ISEA Z358.1-2014. Information given herein is meant to further define installation requirements for compliance with the abovementioned standard and the 2010 ADA Design Guidelines.